



中国认可
检测
TESTING
CNAS L5662



Measurement of Lamp Circuit Power for Luminaire

For

AOK LED Light Company Limited
East of third floor, Building 1, St George's Industrial Park, Shajing street, Baoan District,
Shenzhen, China (Second floor, Building 4, St George's Industrial Park)

Test model: AOK-200WoH-NV-L3-0(B0)

This Report Concerns:

☒ Original Report

Equipment Type:

LED High Bay Light

Compiled by: Herry He

Report No: R2DG171130054-03

Test Date: 2017-12-25
IES LM-79-08

Test Standard IEC 62301:2011

IPART Lighting Equipment Requirements – Commercial
Lighting V2.0

Reference IPART Lighting Requirements - Home Energy Efficiency
Retrofits Method V1.1

VEET -Version 3.2 – 1 April 2017 (Reference: C/13/28223)

Approved By: Daniel Duan

Test location: Bay Area Compliance Laboratories Corp. (Dongguan)

No.69, Pulongcun, Puxinhu Industry Area, Tangxia,
Dongguan, Guangdong, China


Note: The test data was only valid for the test sample(s). This test report is prepared for the customer shown above and for the specific product described herein. It must not be duplicated or used in part without prior written consent from Bay Area Compliance Laboratories Corp. (Dongguan).

Measurement of Lamp Circuit Power for Luminaire

TEST PROCEDURE

1. Set up the test circuit according to the test circuit diagram below;
2. Adjust the AC source to 220V/50Hz and operated for at least 30 minutes;
3. Read the input data(current, wattage and power factor) from the power meter ;
4. Adjust the AC source to 230V/50Hz and operated for at least 30 minutes and repeat step three;
5. Adjust the AC source to 240V/50Hz and operated for at least 30 minutes and repeat step three;

TEST CIRCUIT DIAGRAM:

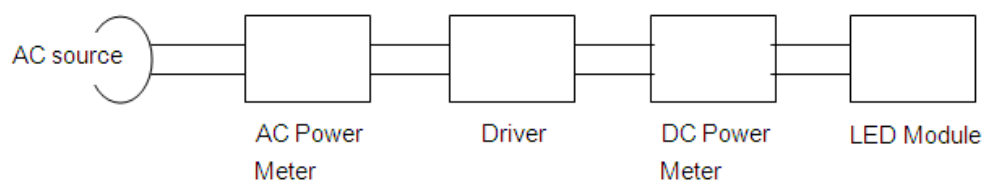

TEST AMBIENT: 25.0°C, 50%RH

For model AOK-200WoH-NV-L3-0(B0) , the lamp output were allowed to be stable conditions before measurements were taken.

TEST EQUIPMENT LIST:

Equipment Description	Model No.	Manufacturer	Serial No.	Last Cal	Cal Due
Power supply	HPA1103	HPC	3393	2017-05-05	2018-05-05
Power meter	WT210	YOKOGAWA	91GC34404	2017-03-02	2018-03-01
Power meter	AN8721P	Ainuo	118706019	2017-12-05	2018-12-04
Stop watch	PC396	Shenzhen hbtimer	N/A	2017-03-05	2018-03-04

GENERAL PRODUCT INFORMATION:

AOK LED Light Company Limited 's product in this report is a LED High Bay Light. Test model is AOK-200WoH-NV-L3-0(B0) with driver model NO. HBG-200-48AB, rated input 100-240Vac, 200W.

Models	Description	Safety Class	Brand Name
AOK-200WoH-NV-L3-0(B0)	LED High Bay Light	I	AOK


Manufacturer:	AOK LED Light Company Limited
Manufacturer address:	East of third floor, Building 1, St George's Industrial Park, Shajing street, Baoan District, Shenzhen, China (Second floor, Building 4, St George's Industrial Park)

TEST DATA:


Test Model:	AOK-200WoH-NV-L3-0(B0)						
Sample No.	1#						
Input					Output		
Voltage (V)	Frequency (Hz)	Current (A)	Wattage (W)	Power factor	Voltage (V)	Current (A)	Wattage (W)
220	50	0.933	199.3	0.976	NA	NA	NA
230	50	0.892	199.2	0.972	NA	NA	NA
240	50	0.860	199.0	0.968	NA	NA	NA

Annex A-EUT photos


1.The top view of model AOK-200WoH-NV-L3-0(B0)

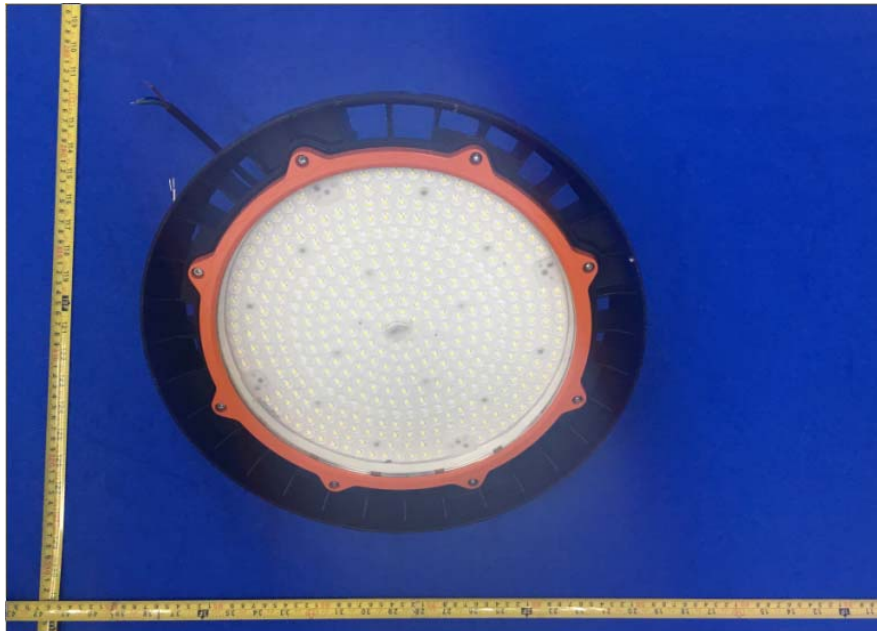

2.The back view of model AOK-200WoH-NV-L3-0(B0)

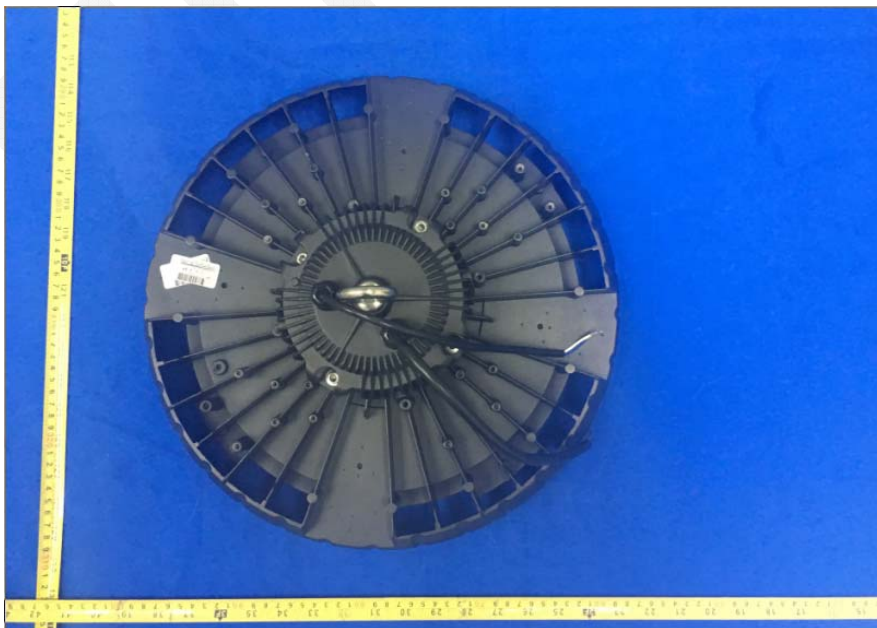

3.The product label view of model AOK-200WoH-NV-L3-0(B0)

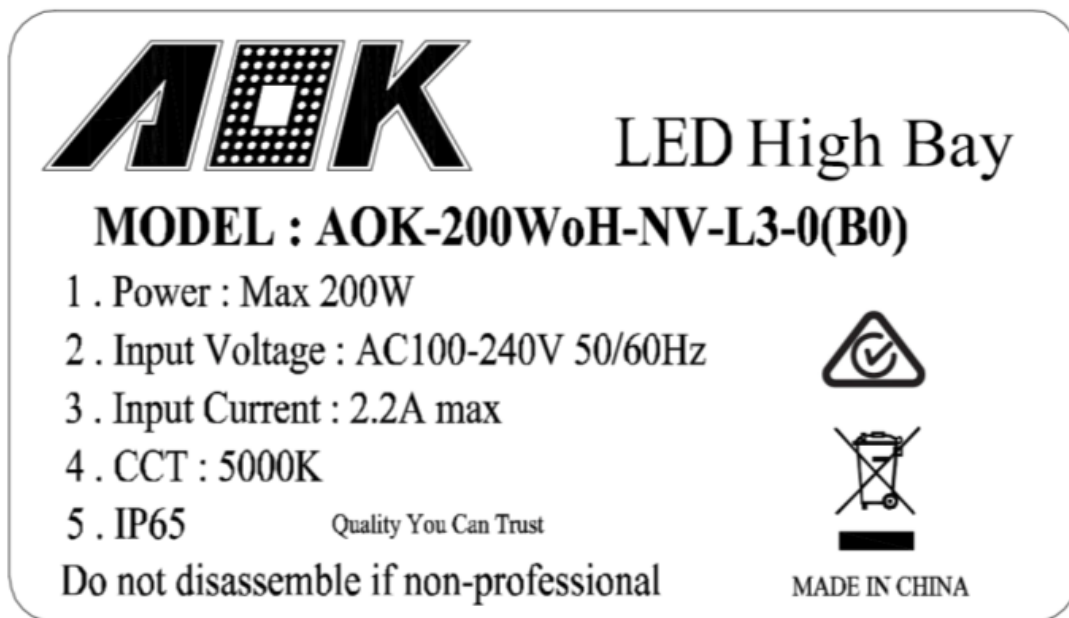

4.The driver label view of model AOK-200WoH-NV-L3-0(B0)



End of report